
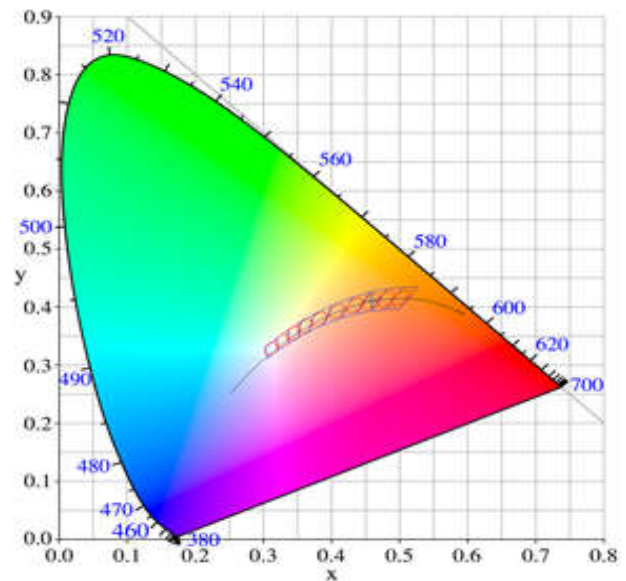


CTR180502-03A 16102CBR27 LM-79 Stabilization			2/15/19	
Description	16102CBR27		Test Time	8:44 AM
Orientation	Base Up		Integration Time	6566.9
Test by	Tyler Thompson		Scans Averaged	3
Notes	Certification		Saturation	81%
Scan ID	Scan id 4001 CTR180502-03A 16102CBR27 LM-79 Stabilization		Sphere Geometry	4pi
			Sphere Temp	24.42

Relative Spectral Power Distribution

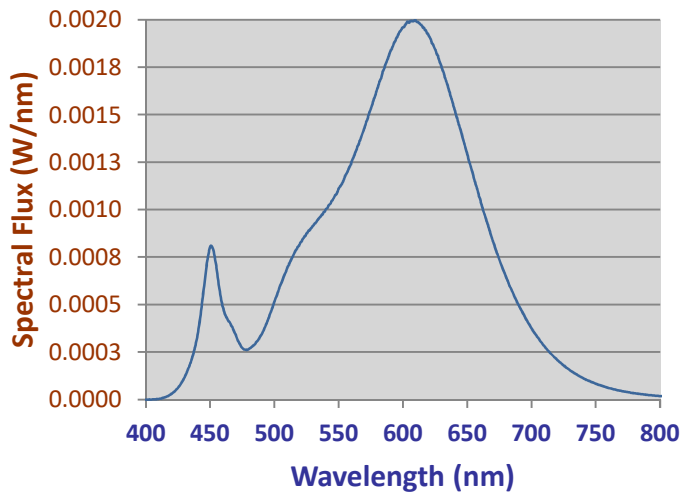

Lumens	Watts	Volts	Amps	Efficacy	PF	ITHD
92.4	1.849	11.975	0.235219	49.93741093	0.656569	9754%

CCT		CRI		x		y		Duv		u'		v'	
2724.0		83.196		0.4592		0.4126		0.0008		0.2612		0.5280	
R1	R2	R3	R4	R5	R6	R7	R8	R9	R10	R11	R12	R13	R14
82	91	97	82	81	89	83	60	12	79	81	72	84	99